



A

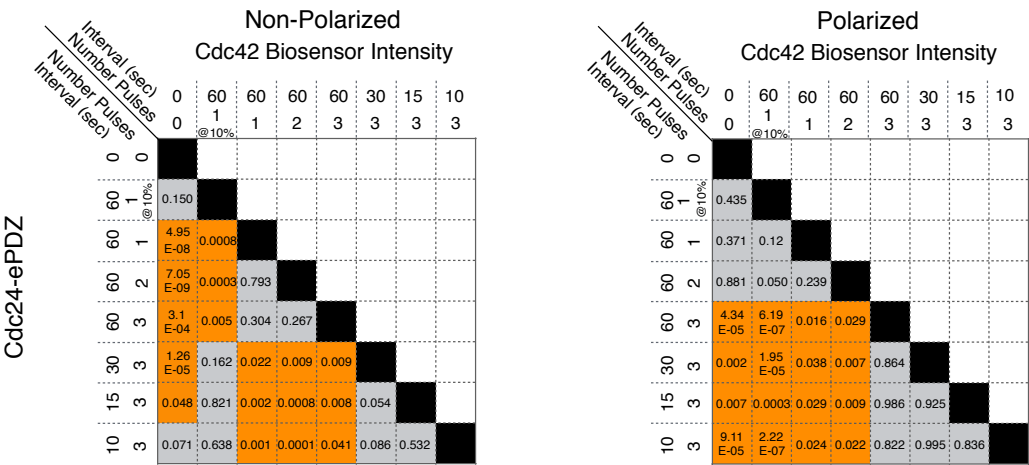

B

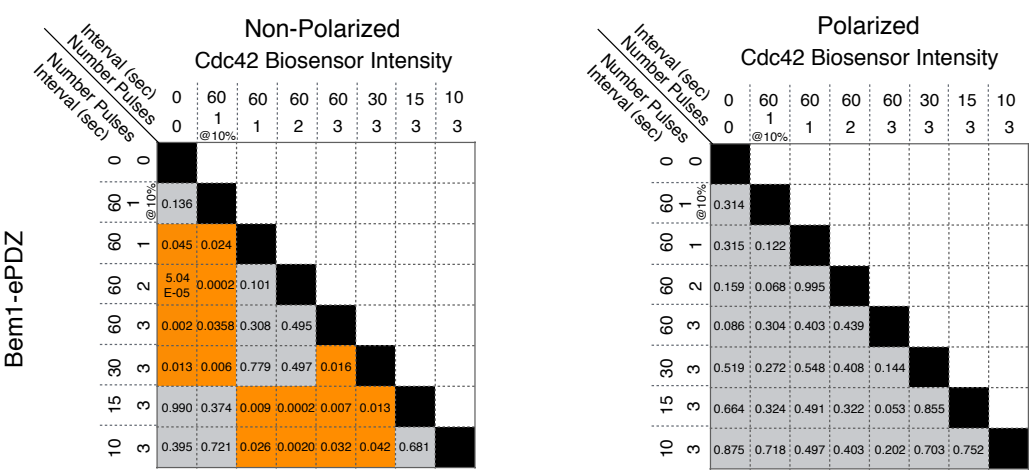

C

Cdc42 Biosensor Intensity in Non-Polarized versus Polarized Cells

Interval (sec)	0	60	60	60	60	30	15	10
Number Pulses	0	1	1	2	3	3	3	3
		@10%						
Cdc24-ePDZ	5.7 E-08	1.04 E-06	7.26 E-09	2.78 E-06	8.11 E-05	1.01 E-06	0.059	0.0803
Bem1-ePDZ	0.013	1.41 E-05	0.012	1.47 E-08	0.003	0.002	0.008	0.009