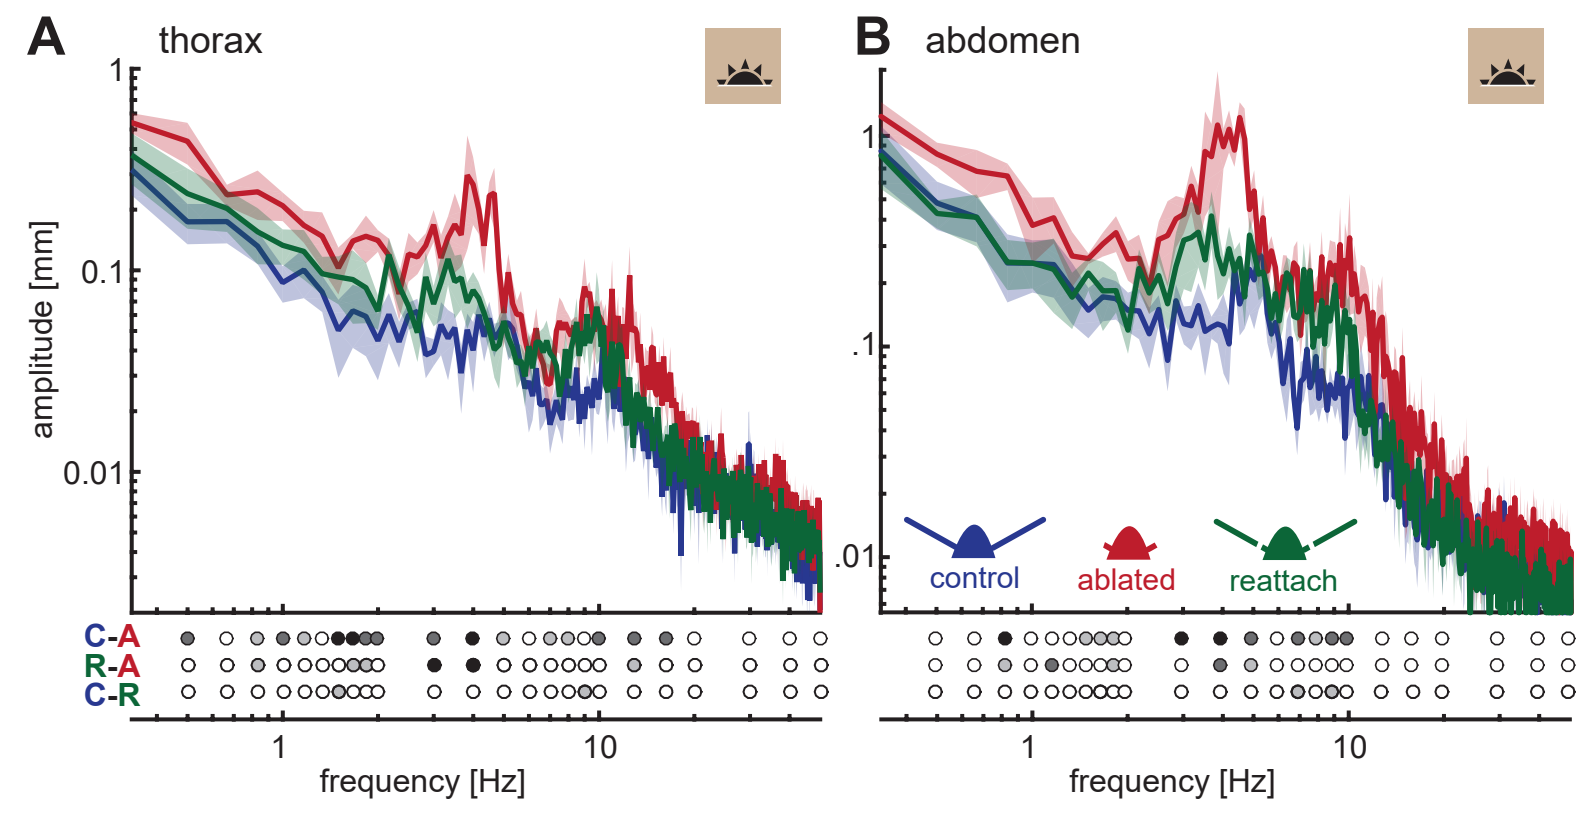
A
thorax
B
abdomen
amplitude [mm]
1
0.1
0.01
.1
.01
control
ablated
reattach
C-A
R-A
C-R
1
10
frequency [Hz]